


MOHAVE COUNTY PLANNING AND ZONING DEPARTMENT, DIVISION OF BUILDING INSPECTION  
ABOVE GROUND POWER SERVICE

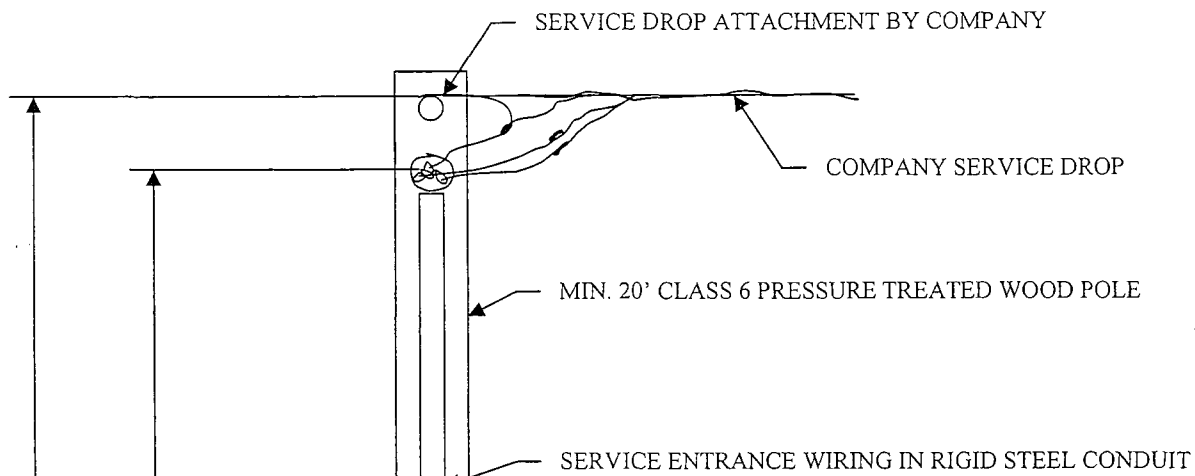

NOTE: OTHER STATE AND/OR LOCAL  
CODES MAY APPLY

OVERCURRENT DEVICE (FUSE OR BREAKER)  
TO CONFORM TO N.E.C.

SIZE	COPPER	ALUMINUM	CONDUIT
100 AMP	#4 WIRE	#2 WIRE	1 1/2"
200 AMP	#2 / 0 WIRE	#4 / 0 WIRE	2"

**PLEASE POST  
BUILDING ADDRESS  
NUMBERS  
THEY MUST BE LEGIBLE  
FROM THE STREET**

If resistance >25 ohms, install  
second rod min 6 ft. apart

N.E.C. APPROVED TYPE OF GROUND CLAMP AND 5/8" OR  
LARGER COPPER WELD GROUND ROD DRIVEN TO A  
DEPTH OF 8'